

Burner control unit FDA 601x



EN 298 / EN 230 2012

19" PCB 100x160mm 3HE/8TE
 socket DIN 41612

2-channel microprocessor
 controlled program

air valve control for
 heating / cooling prevention

continuous operation with
 ionisation

intermittent operation with UV cell

continuous operation UV with
 PWA 6013/6014 and fail-safe UV-
 flame detector (ex. FD 3025)

suitable for impulse-firing-systems

optional:

rinsing of the burner and work
 with external allowed time and
 „air valve“ indicator,
 HEATING / COOLING mode.

The burner control system FDA / PWA 601x is designed for operation at continuous operating heat treating units. The universal use and also the easy integration in the main system are specific for this control unit.

It also complies to the requirement of the newest European Standard EN 298 and EN 230.

Burner control unit FDA 601x

Description

The electronic control is fail-safe against external electrical influences and corresponds to the hardest industrial conditions. The reproducible program sequence precise by microprocessor technology works autonomously without auxiliary and utility systems. The control inputs are non-reactively connectable. The failure message contacts can be included into external signal circuits. The operating voltage of the fuel valves can deviate from the auxiliary voltage of the controller. The following

additional functions are because of our customer's requests:

- Burner pre-ventilation with external timing and a additional LED display „Air valve“.
- Heating / cooling- pre-selection of operation mode by Split-Range-Controller.
- Ignition repeat with max. 3 program cycles accord. to EN 746-2.


Spezifikation

	FDA 6011	PWA 6013	FDA 6014	FDA 6018	FDA 6019
flame detector					
continuous internal	ionisation	-	ionisation	ionisation	ionisation
continuous external	-	UV*	-	-	-
intermeitted internal	UV	-	UV	UV	UV
fuel valves	2	2	2	2	2
optional					
air valve	-	-	1	-	1
mode	-	-	rinse	ignition repeat	cooling / heating

* external flame detector, e.g. FD 3025, for continuous operation.

Program run for FDA 6011 - PWA 6013

FDA 6011 / PWA 6013 - 2-stange standard version.

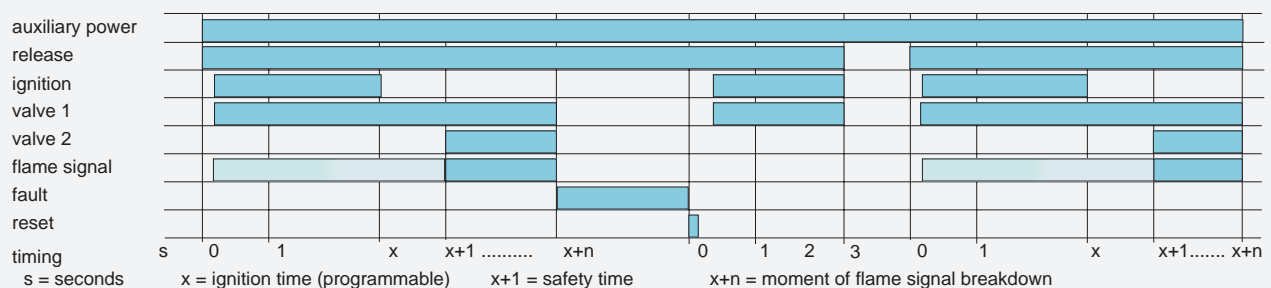

DATASHEET

Burner control unit FDA 601x


FDA 6011 with integrated flame monitor for continuous operation by ionisation monitoring with sensor electrode and intermittent by UV monitoring with UV cell, such as P607 or R1848.

PWA 6013 with external flame monitor such as FD 3025, for continuous duty.

Program run for FDA 6014

FDA 6014 - 2 stage version with an additional output and input to piloting a air valve. The air valve is at any time insertable also outside of the program cycle.


It serves for not safety-related rinsing of the burner and works with external allowed time.

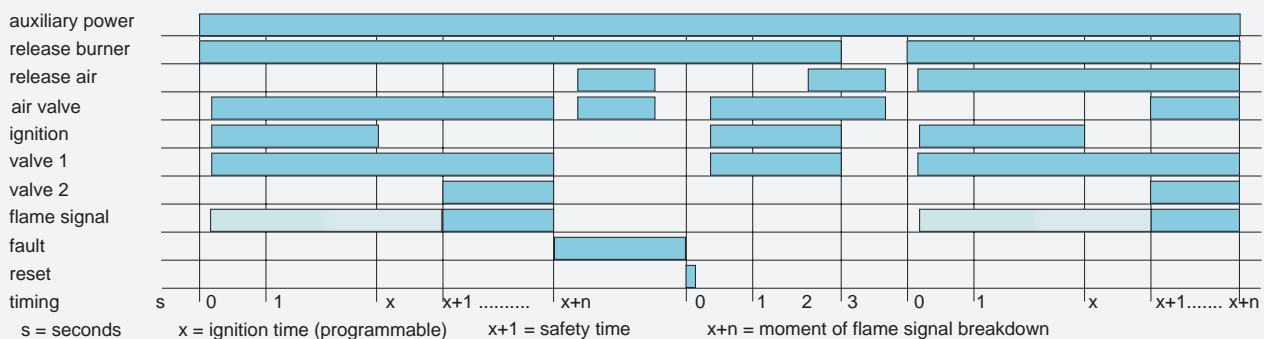

Program run for FDA 6018

FDA 6018 – ignition repeat with max. 3 program cycles accord. to EN 746-2.
10 sec. dead time between the program cycles.

- Optimised functionality by program analysis „rugged combustion“:
If flame loss should be recognized during one of the two first program cycles, within 5 seconds at expiration of the safety time, the program goes to the ignition repeat routine.

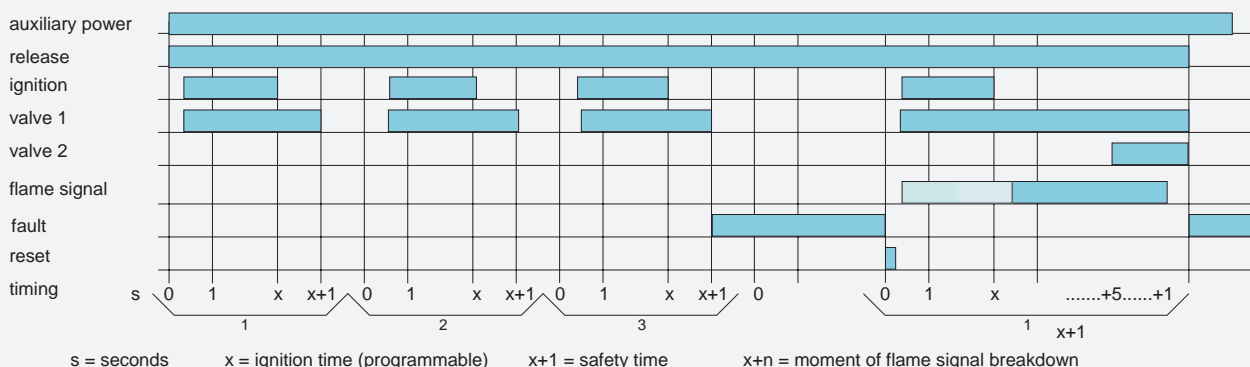


After failure and reset again all re-ignitions are available.

DATASHEET

Burner control unit FDA 601x

Program run for FDA 6019

FDA 6019 –2 stage version for operation at impulse firing with operation mode heating / cooling. Separate output for the air valve and preselection of operation mode.

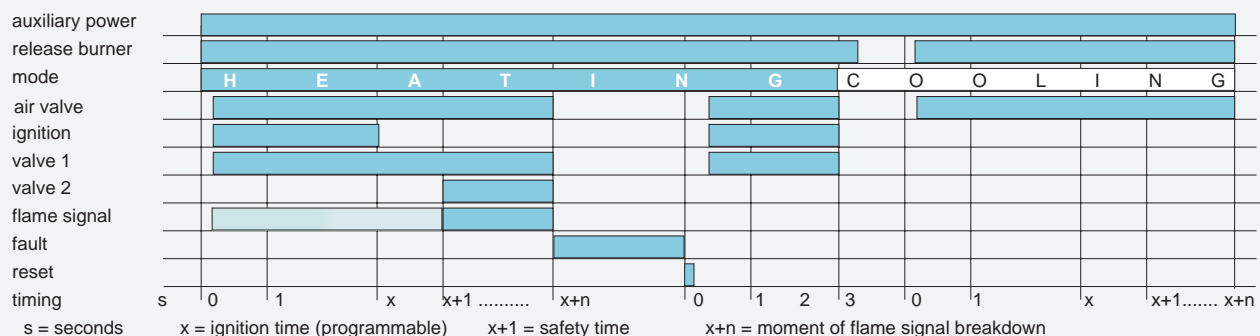

Technical data

operating voltage

115V or 230V, 50/60Hz; -10% / +15%

current consumption

at 230V - appr. 26mA, at 115V - appr. 52mA

loading

approx. 6,0VA

power loss

max. 4,2W

safety times

3 - 5 - 7 - 10 seconds for all constructions.

flame detector

- continuous duty operation
- accord. to EN298 and N230.
- UV-operation intermittent.
- UV-continuous duty operation at PWA 6013 with external continuing licensed flame monitor by a separate input.

FDA-flame signal

>1...2µA, metering points on the front panel,

metering without current circuit interruption, maximum 30µA.

Attention: High voltage!

≥ 2µA - ON
≤ 1,5µA - OFF

temperature range

0°C / +60°C

program run

microprocessor controlled,
no waiting time between two cycles.

design

plug in card 100x160mm with front plate 3HE/8TE, multipoint connector accord. DIN 41612 model F, series z + d, 32pin, for module rack accord. DIN 41491.

weight

570g


protection class

IP00

Burner control unit FDA 601x


Connection example 1/5 for FDA 6011 / 6018

Monitoring of ionisation with separate ignition- and monitoring electrode.

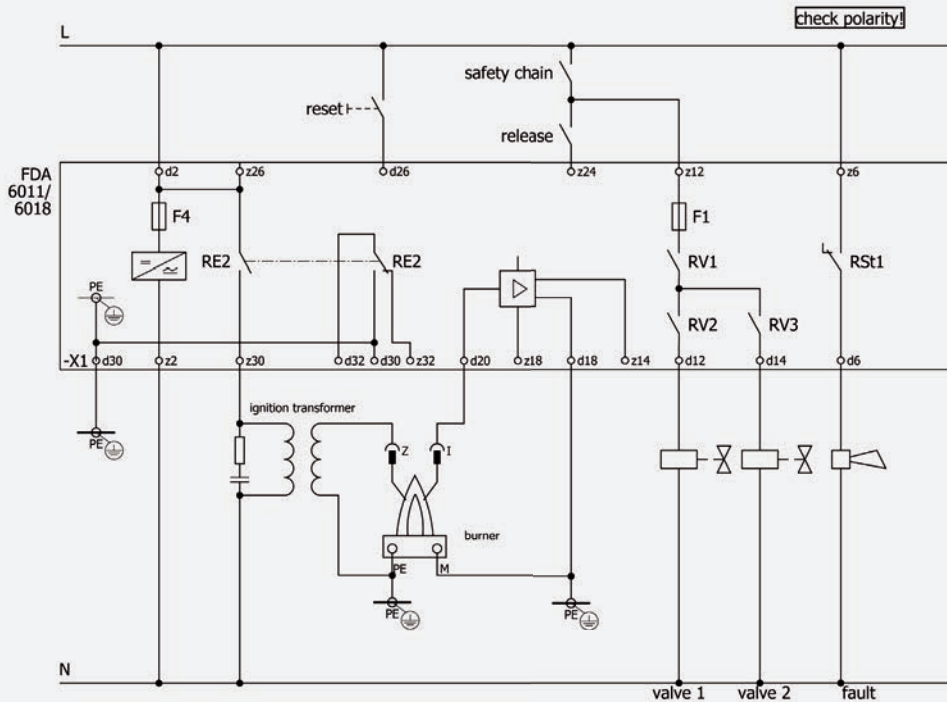

Connection example 2/5 for PWA 6013

Monitoring of ionisation with external flame detector / signaling contact input.

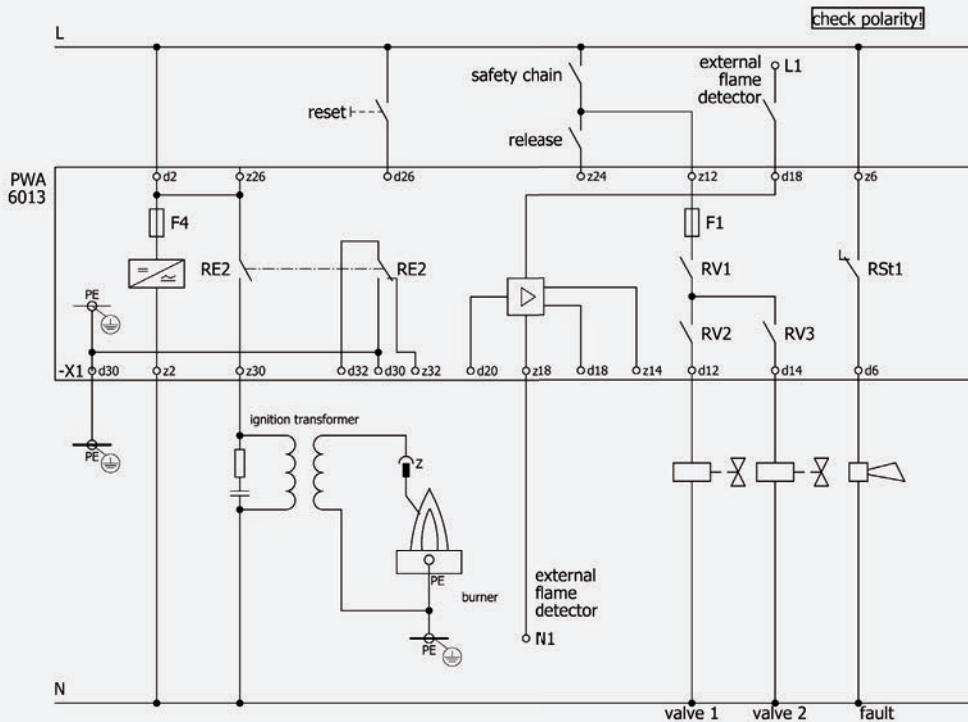


DATASHEET

Burner control unit FDA 601x


Connection example 3/5 for FDA 6014

Monitoring of ionisation with separate ignition- and monitoring electrode.

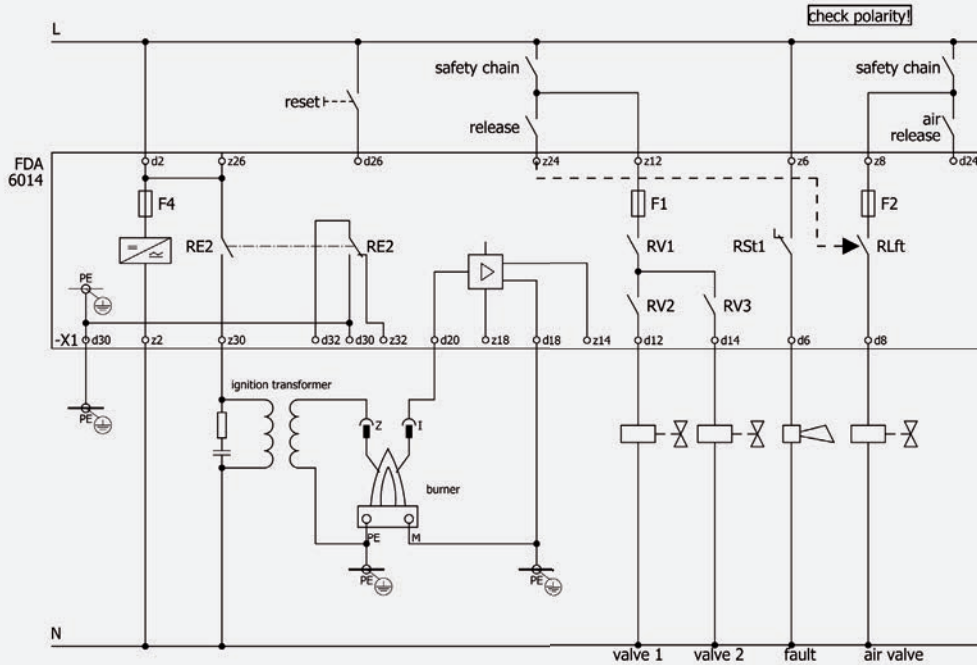

Connection example 4/5 for FDA 6019

Monitoring of ionisation with separate ignition- and monitoring electrode.

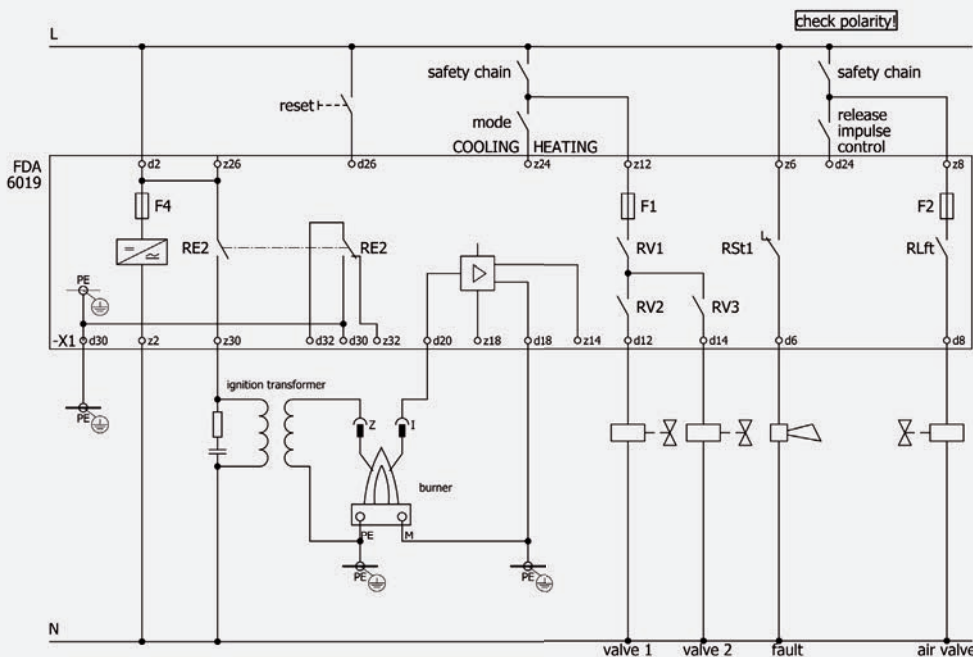


DATASHEET

Burner control unit FDA 601x

Types of monitoring for FDA 601x

Monitoring of ionisation with common / separate ignition- and monitoring electrode, monitoring with UV-tube.

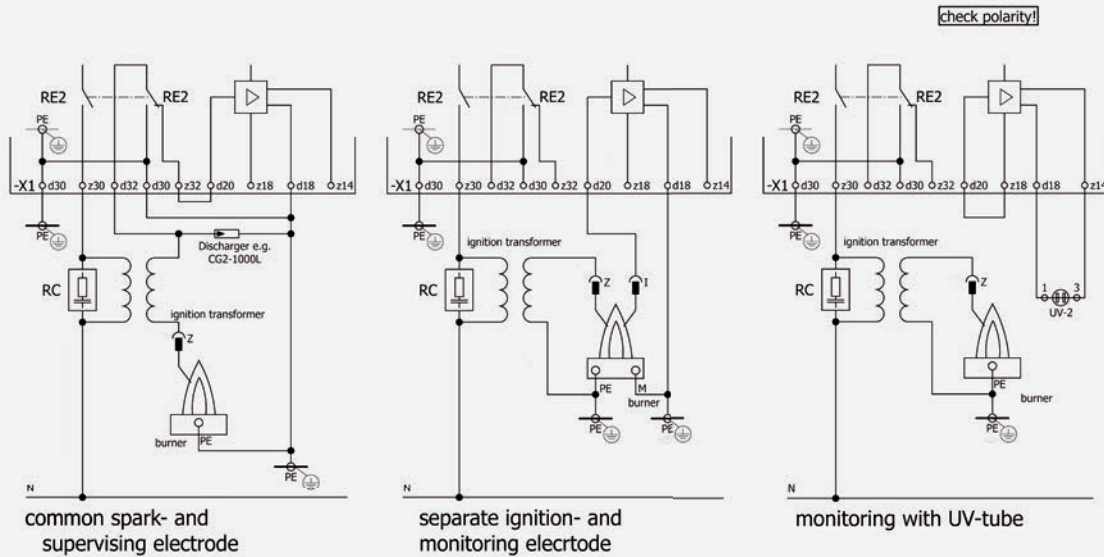

Contact load

	ignition	valve 1 + 2	air valve	fault
V AC				
max. load	500VA	250VA	250VA	250VA
max. voltage	250V	250V	250V	250V
max. current	2A	1A	1A	1A
V DC				
max. load	---	24W	100W	100W
max. voltage	---	24V *	100V	100V
circuit breaker external	---	---	---	1A
circuit breaker internal	---	T1A	T1A	---

***Attention!**

do not use for low-voltage protection (VDE 0100 DIN 40803) VDE 0860/08.91

Burner control unit FDA 601x

Urgent advise

The declared values valve 1 + 2 are the maximum sum of the individual valve datas, $\cos.\Phi = 0,6$, because relays F1 has to switch the total current.

The switching contacts should be in principle wired after mode of operation:

- a. AC voltage: RC-combination or varistor (metallic oxide)
- b. DC voltage: free-wheeling diode ($U_s > 5 \times U_v$)

Switching frequency:

at $\cos.\Phi = 1,0$: $2,5 \times 10^5$
 at $\cos.\Phi = 0,6$: $2,5 \times 10^5$

Maximum length of cable:

Ionisation monitoring max. 75m by separate cable laying of the Power cable by cable quality single wired ignition cable type SIHFZU min. $1 \times 1\text{mm}^2$.
 UV-monitoring max. 50m by cable quality Ölflex type YSCY-J.
 All other cables max. 500m by cable quality Ölflex.

Special regulations of the plant operators are to be considered absolutely!

CE-No.: 0063 BT 1053

All rights reserved. Transfer, processing and reproduction of this publication or parts thereof, without the express permission of the company HANS HENNIG GmbH, is forbidden.

Technical modifications, which serve the progress, are reserved.

Burner control unit FDA 601x

Appendix to burner control unit FDA 60xx

For a failure-free operation of the burner control unit FDA 60xx, you should pay attention on the early stage of development. Additional modifications on existing plants increase the costs. To prevent unnecessary expenses, please follow the remarks.

General

The burner control unit FDA 60xx is certificated and subjected to EN 298/230. Installation and handling of the burner control unit FDA 60xx by authorised specialists only.

Advice for cable laying outside the switchboard:

- The distance between ignition transformer and burner should be not more than 2 meter.
- The ionisation cable can be up to 75 meter long, if an ignition cable is used.
- Don't lay the ignition cable in a metal tube or pipe.
- Under no circumstances you should lay the ignition and the ionisation cable together.
- In general, unshielded cores shouldn't be in a cable together with the feeder cores.
- Separate laying of measuring- / data cores and high voltage current cores or cables.
- There has to be a good protection earth (ground) connection between burner and transformer box.

Advice for the installation inside the switchboard:

- Electronically components should be installed in shielded areas, according to there sensitivity.
- Don't install the burner control unit FDA 50xx close to a frequency converter or transformers.
- If a power transformer is used, we advice a power transformer with shield winding.
- Valves, contactors, relays and ignition transformers must have a protective circuit as follows:
 - DC voltage: recovery diode;
 - AC voltage: RC-combination / varistor parallel to the coil;
- Earthing measures:
 - Decide on a adequate central earth point, which receives all earth cores and shields.
 - In an exceptional case it could be necessary to lay the shield on a separate terminal block.
 - The cross-section of an earth core must be big enough.
 - A loop laying of an earth core must be avoided.
 - Every earthing must be direct on the central earth bar and on the feeder earth.

Before initial start-up of burner control unit FDA 60xx check the following:

- The phasing of voltage must be adhered.
- Has the burner control unit got fluctuation of temperature, otherwise it is for seeing, that no condensation water arose.
- Is the voltage supply identical to the specification on the burner control unit (link on the blank).
- Under no circumstances pull out the burner control unit during operation.